

# PH30 19×1.5mm<sup>2</sup>

## Fire Alarm Cables

NO.7110419



### CABLE CONSTRUCTION:

<b>Conductor:</b>	1.5mm(sqmm) Plain annealed copper wire, class 1,2 or 5 according to EN60228.
<b>Insulation:</b>	Fire resistant silicone rubber BS 6387 CWZ,EN 50200 PH30,IEC 60331 Dia.over Dielectric:12x(0.0102"(2.6 mm))
<b>Insulation Color:</b>	Brn/Blk/Whi
<b>Separator:</b>	PET Foil
<b>Drain Wire:</b>	0.80 mm Solid tinned copper
<b>Shield:</b>	Aluminum PET (100% Coverage 20% overlapping) FR-LSZH (Red or White)
<b>Jacket:</b>	Dia.over Jacket: 0.669"±0.006"(17.0±0.15mm) HFFR EN 502902,BS7655 LTS1/LTS3
<b>Print Legend:</b>	HELLOSIGNAL Fire Alarm Cable PH30 1.0mm <sup>2</sup> 19 Cores Class N BC BS 50200:2006 NO.7110419 ***M/FT




### ELECTRICAL PROPERTIES(at20°C):

<b>Min.Bend Radius:</b>	8×Diameter
<b>Min.Insulation resistance:</b>	200 MΩ/km
<b>Max.Working Temperature:</b>	-30°C~+90°C
<b>Test voltage:</b>	2000 V
<b>Max.Operating voltage:</b>	300 V / 600 V
<b>Max.resistance of Cond:</b>	Class1,2: 12Ω/km                      Class5: 12.9Ω/km
<b>Current Carrying Capacity:</b>	
<b>Nominal Capacitance:</b>	

### Cross Section :

#### Ph30 19×1.5mm<sup>2</sup>

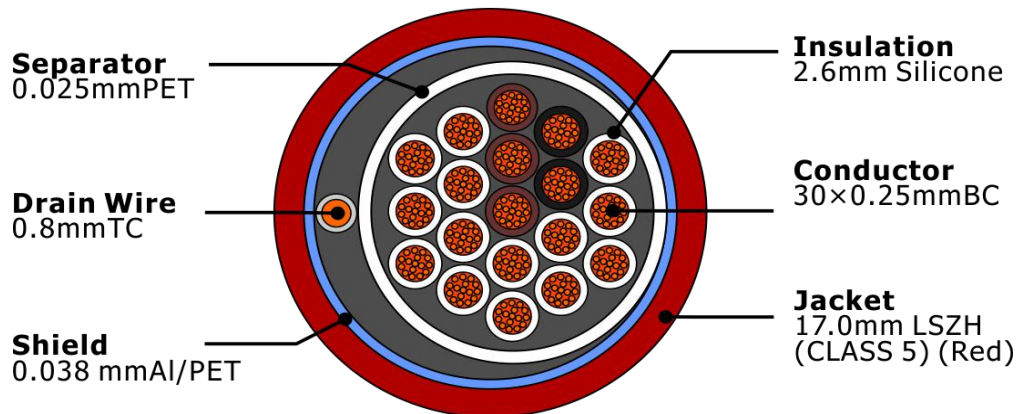

#### Insulation Color

● Brn x3 ● Blk x2 ○ Whi x14

---

## Test Standards

Flame Tests	Insualtion Integrity	Smoke Density	Corrosive Gas Easurement
BS 4066 part 1 & 3	IEC 60331	BS 7622	BS EN 50267-2-2
EN 50266-2-4	BS 6387 CWZ	IEC/EN 61034	IEC 60754-2
IEC 60332-3-24	EN 50200 PH30	HD 606	
IEC/EN 60332-1			

---

## Order Informations :

Package	100M/Wooden Spool,200M/Wooden Spool,500M/Wooden Spool
Delivery time	Normally 25 days after received the deposit.
Brand	HELLOSIGNAL™ OR OEM

---

## Online Service :

Skype	kingtone3
ICQ	246632889
Whatsapp	0086 18268009191
Email	michael@zion-communication.com



**[www.zion-communication.com](http://www.zion-communication.com)**  
**HANGZHOU ZION COMMUNITION CO.,LTD**